


AquaGo INSTRUCTION MANUAL

REPLACING FILTER CARTRIDGE-ELKAY or MURDOCK DRINKING FOUNTAIN

STEP 1:

- SWITCH OFF POWER AND WATER SUPPLY.
- DISPENSE WATER TO RELIEVE PRESSURE.

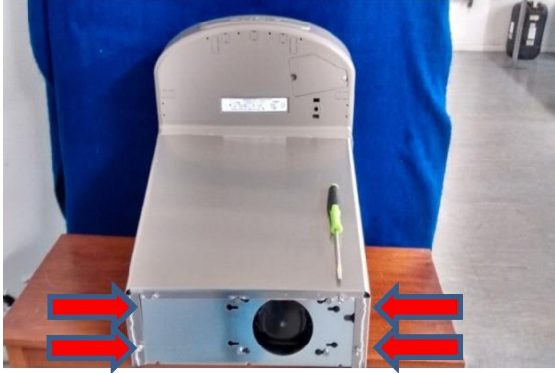

STEP 2:

REMOVE FOUR SCREWS SITUATED AT THE BASE OF THE COOLER USING A FLAT HEADED SCREWDRIVER.




STEP 3:

ONCE THE SCREWS HAVE BEEN REMOVED - SLIDE THE SHROUD DOWNWARDS.



STEP 4:

CAREFULLY PLACE THE SHROUD AWAY FROM THE COOLER.

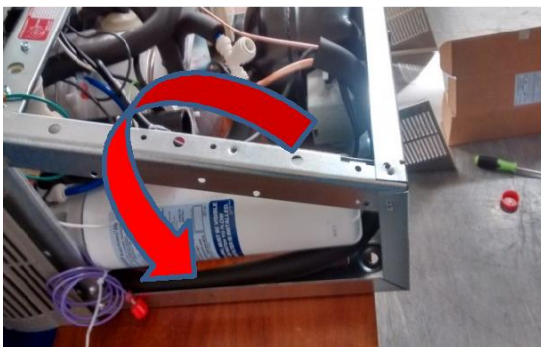

STEP 5:


REMOVE THE EXISTING FILTER CARTRIDGE BY TURNING IT ANTI-CLOCKWISE (¼ TURN).

2




STEP 6:

REMOVE THE RED CAP COVER OFF THE NEW FILTER CARTRIDGE.

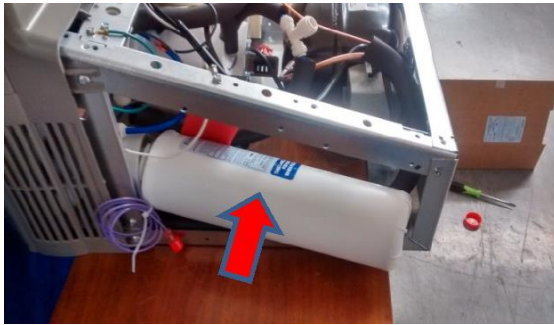

STEP 7:

CAREFULLY SLIDE THE NEW FILTER CARTRIDGE INTO THE FRAME OF THE COOLER AND POSITION UNDER THE FILTER HEAD.

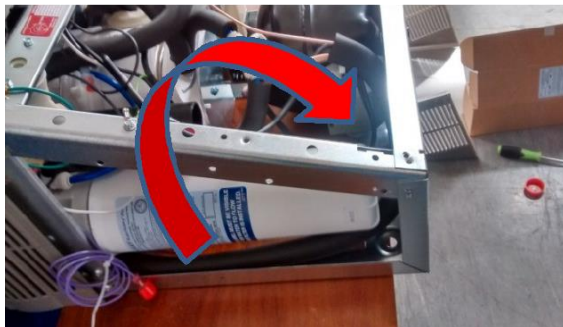

STEP 8:

ENSURE THE NEW FILTER CARTRIDGE IS DIRECTLY IN LINE WITH THE FILTER HEAD AND TURN THE CARTRIDGE CLOCKWISE (¼ TURN).




STEP 9:

REPLACE THE SHROUD AND ENSURE ALL WIRES AND TUBES ARE NEATLY PLACED INSIDE THE COOLER.



STEP 10:

WHEN SLIDING THE SHROUD ONTO THE COOLER ENSURE THAT THE METAL SHROUD SLIDES UNDER THE PLASTIC BASIN SHROUD

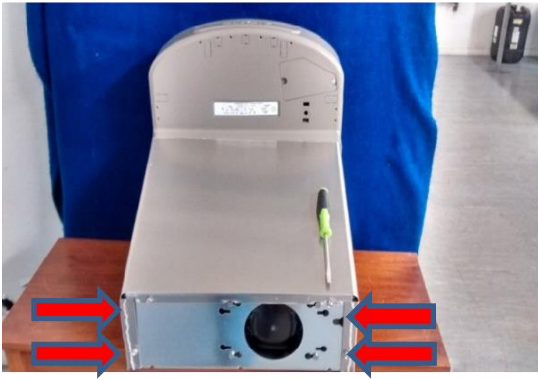**STEP 11:**

REPLACE SCREWS AT THE BASE OF THE COOLER USING A FLAT HEADED SCREWDRIVER.

STEP 12:

TURN ON WATER SUPPLY AND RUN A MINIMUM OF 9 (NINE) LITRES OF WATER THROUGH THE NEW FILTER TO PURGE AIR AND FINE CARBON PARTICLES FROM FILTER.

**STEP 13:**

TO RESET THE FILTER MONITOR - REMOVE THE COVER PLATE FROM THE TOP OF THE BOTTLE FILLING STATION BY UNSCREWING TWO SCREWS FROM THE TOP.

**STEP 14:**

- DEPRESS THE PROGRAM BUTTON FOR APPROXIMATELY 2 SECONDS UNTIL THE DISPLAY CHANGES THEN RELEASE THE BUTTON.
- THE DISPLAY WILL CHANGE AND SCROLL THROUGH TWO MESSAGES. "RST FLTR" - RESET FILTER MONITOR. "SETTINGS" - SYSTEM SETTINGS SUB MENU.
IF THE PROGRAM BUTTON IS NOT PUSHED AGAIN THE DISPLAY WILL SCROLL THROUGH THE TWO MESSAGES ABOVE FOR THREE CYCLES AND THEN DEFAULT BACK TO BOTTLE COUNT AND BE BACK IN RUN MODE.
- WHEN THE DISPLAY CHANGES TO "RST FLTR", DEPRESS THE BUTTON AGAIN. THE DISPLAY CHANGE TO SHOW "FLTR=0".
- THE GREEN LED SHOULD BE ILLUMINATED INDICATING THAT THE VISUAL FILTER MONITOR HAS BEEN RESET.



P: (09) 275-5019 (NZ) or 1800-218-662 (AU)
sales@aquago-chemchek.com